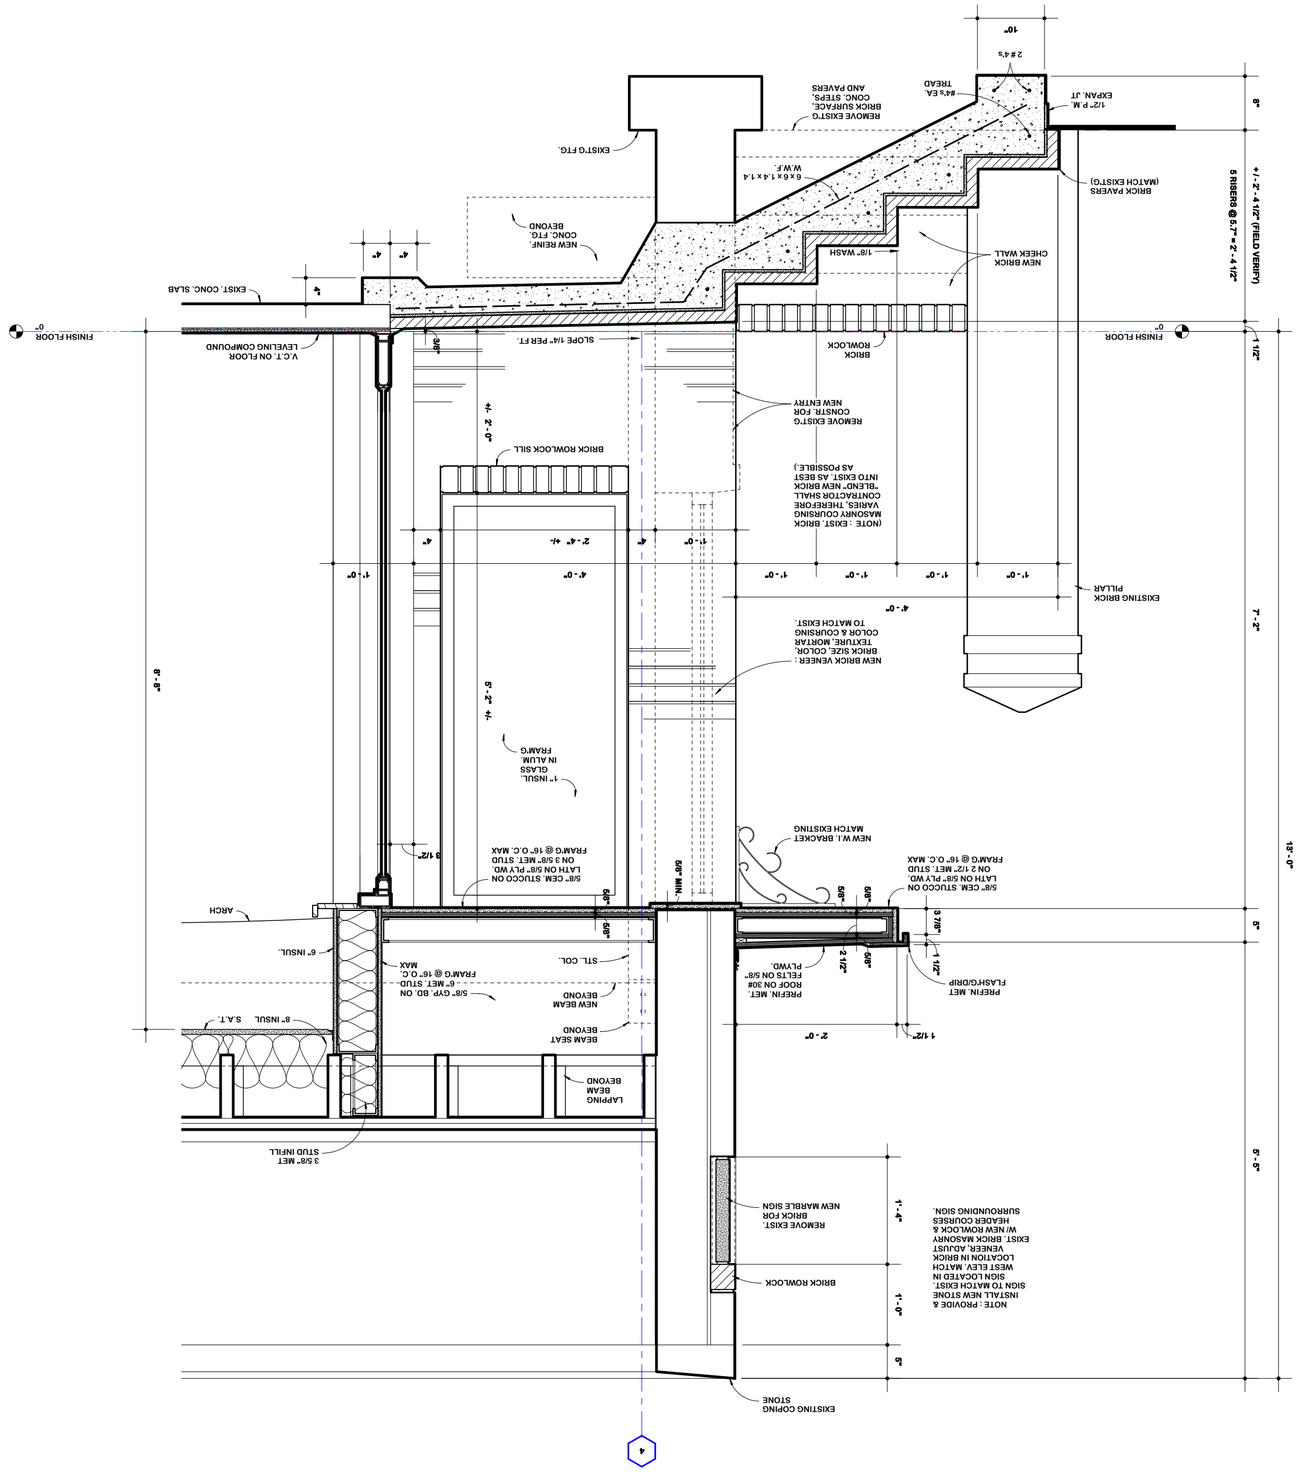
10"
2 # 4's
#4's EA.
TREAD
1/2" P.M. EXPAN. JT
REMOVE EXIST'G BRICK SURFACE, CONC. STEPS, AND PAVERS
EXIST'G FTG.
6 x 6 x 1.4 x 1.4 W.W.F.
BRICK PAVERS (MATCH EXIST'G)
5 RISERS @ 5.7" = 2' - 4 1/2"
+/- 2' - 4 1/2" (FIELD VERIFY)
6"
1/8" WASH
NEW BRICK CHEEK WALL
NEW REINF. CONC. FTG. BEYOND
4"
4"
4"
EXIST. CONC. SLAB
FINISH FLOOR
0"
V.C.T. ON FLOOR LEVELING COMPOUND
SLOPE 1/4" PER FT.
BRICK ROWLOCK
1 1/2"
REMOVE EXIST'G CONSTR. FOR NEW ENTRY
(NOTE : EXIST. BRICK MASONRY COURSING VARIES, THEREFORE CONTRACTOR SHALL "BLEND" NEW BRICK INTO EXIST. AS BEST AS POSSIBLE.)
BRICK ROWLOCK SILL
+/- 2' - 0"
4"
2' - 4" +/-
4"
1' - 0"
1' - 0"
1' - 0"
1' - 0"
1' - 0"
1' - 0"
4' - 0"
4' - 0"
EXISTING BRICK PILLAR
7' - 2"
NEW BRICK VENEER : BRICK SIZE, COLOR, TEXTURE, MORTAR COLOR & COURSING TO MATCH EXIST.
8' - 8"
+/- 5' - 2"
1" INSUL. GLASS IN ALUM. FRAM'G
3 1/2"
NEW W.I. BRACKET MATCH EXISTING
5/8" CEM. STUCCO ON LATH ON 5/8" PLY WD. ON 3 5/8" MET. STUD FRAM'G @ 16" O.C. MAX
5/8" CEM. STUCCO ON LATH ON 5/8" PLY WD. ON 2 1/2" MET. STUD FRAM'G @ 16" O.C. MAX
5/8" MIN.
5/8"
5/8"
5/8"
5/8"
3 7/8"
1 1/2"
2 1/2"
PREFIN. MET. FLASH'G/DRIP
PREFIN. MET. ROOF ON 30# FELTS ON 5/8" PLYWD.
5' - 5"
2' - 0"
1 1/2"
ARCH
6" INSUL.
STL. COL.
6" MET. STUD FRAM'G @ 16" O.C. MAX
5/8" GYP. BD. ON
NEW BEAM BEYOND
BEAM SEAT BEYOND
8" INSUL. S.A.T.
LAPPING BEAM BEYOND
3 5/8" MET STUD INFILL
REMOVE EXIST. BRICK FOR NEW MARBLE SIGN
1' - 4"
BRICK ROWLOCK
1' - 0"
5"
NOTE : PROVIDE & INSTALL NEW STONE SIGN TO MATCH EXIST. SIGN LOCATED IN WEST ELEV. MATCH EXIST. BRICK MASONRY LOCATION IN BRICK VENEER, ADJUST HEADER COURSES W/ NEW ROWLOCK & SURROUNDING SIGN.
EXISTING COPING STONE
15' - 0"
5' - 5"
4